

IAPMO IGC 396-20yy



PUBLIC REVIEW DRAFT

Industry Standard for
Water Closet Flange



IAPMO Standard

Approval of an IAPMO Industry Standard requires verification by the Standards Review Committee that the standard has been developed in accordance with the policies and procedures for standards development (S-001, *Standards Development Process*, S-008, *Appeals* and S-011, *Operation of the IAPMO Standards Review Committee*). Although IAPMO administers the process and establishes rules to promote fairness in achieving consensus, it does not independently test, evaluate, or verify the content of standards.

Consensus is established when substantial agreement has been reached by directly and materially affected interests. Substantial agreement means much more than a simple majority, but not necessarily unanimity. Consensus requires that all views and objections be considered, and that a concerted effort be made toward their resolution.

The use of IAPMO Industry Standards is completely voluntary; their existence does not in any respect preclude anyone, whether they have approved the standards or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standards.

The Standards Review Committee has final authority on interpretation of any IAPMO Industry Standard. Furthermore, IAPMO designated staff shall have the right and authority to issue an interpretation of an IAPMO Industry Standard in the name of IAPMO. Requests for interpretations should be addressed to the secretariat or sponsor whose name appears on the title page of this standard.

CAUTION NOTICE: This IAPMO Industry Standard may be revised or withdrawn at any time. The policies and procedures require that action be taken periodically to reaffirm, revise, or withdraw this standard. Interested stakeholders of IAPMO Industry Standards may receive current information on all standards by [signing up to receive updates and notices](#) at the IAPMO Standards website www.IAPMOstandards.org.

Published by

International Association of Plumbing and Mechanical Officials (IAPMO)

4755 East Philadelphia Street, Ontario, California, 91761, USA

1-800-854-2766 • 1-909-472-4100

Visit the IAPMO Online Store at: www.IAPMOstore.org

Visit the IAPMO Standards website at: www.IAPMOstandards.org

Copyright © **yyyy-20yy** by International Association of Plumbing and Mechanical Officials (IAPMO)
All rights reserved.

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without prior written permission of the publisher.

Printed in the United States of America

Contents

Preface

IAPMO Standards Review Committee

1 Scope

- 1.1 Scope
- 1.2 Alternative Materials
- 1.3 Terminology
- 1.4 Units of Measurement

2 Reference Publications

3 Definitions and Abbreviations

- 3.1 Definitions
- 3.2 Abbreviations

4 General Requirements

- 4.1 Water Closet Flange Materials
- 4.2 Coatings
- 4.3 Fasteners
- 4.4 Gaskets
- 4.5 Design and Construction Dimensions
- 4.6 Mechanical Water Closet Flange

5 Markings and Accompanying Literature

- 5.1 Markings
- 5.2 Visibility
- 5.3 Installation Instructions

Preface

This is the first edition of IAPMO IGC 396, Water Closet Flange.

This Standard was developed by the IAPMO Standards Review Committee (SRC) in accordance with the policies and procedures regulating IAPMO industry standards development, Policy S-001, Standards Development Process. This Standard was approved as an IAPMO Industry Standard on **Month yy, 2023**.

Notes:

- (1) *The use of the singular does not exclude the plural (and vice versa) when the sense allows.*
- (2) *The use of IAPMO Standards is completely voluntary; their existence does not in any respect preclude anyone, whether he has approved the standards or not, from manufacturing, marketing, purchasing, or using products, processes, or procedures not conforming to the standards.*
- (3) *This standard was developed using an open process and in accordance with IAPMO Standards Policy S-001, Standards Development Process, which is available on the IAPMO Standards website (www.IAPMOstandards.org).*
- (4) *During its development, this Standard was made available for public review, thus providing an opportunity for additional input from stakeholders from industry, academia, regulatory agencies, and the public at large. Upon closing of public review, all comments received were duly considered and resolved by the IAPMO Standards Review Committee.*
- (5) *This Standard was developed in accordance with the principles of consensus, which is defined as substantial agreement; consensus implies much more than a simple majority, but not necessarily unanimity. It is consistent with this definition that a member of the IAPMO Standards Review Committee might not be in full agreement with all sections of this Standard.*
- (6) *Although the intended primary application of this Standard is stated in its scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.*
- (7) *IAPMO Standards are subject to periodic review and suggestions for their improvement will be referred to the IAPMO Standards Review Committee. To submit a proposal for change to this Standard, you may send the following information to the International Association of Plumbing and Mechanical Officials, Attention Standards Department, at standards@IAPMOstandards.org or, alternatively, at 4755 East Philadelphia Street, Ontario, California, 91761, and include "Proposal for change" in the subject line:*
 - (a) *standard designation (number);*
 - (b) *relevant section, table, or figure number, as applicable;*
 - (c) *wording of the proposed change, tracking the changes between the original and the proposed wording; and*
 - (d) *rationale for the change.*
- (8) *Requests for interpretation should be clear and unambiguous. To submit a request for interpretation of this Standard, you may send the following information to the International Association of Plumbing and Mechanical Officials, Attention Standards Department, at standards@IAPMOstandards.org or, alternatively, at 4755 East Philadelphia Street, Ontario, California, 91761, and include "Request for interpretation" in the subject line:*
 - (a) *the edition of the standard for which the interpretation is being requested;*
 - (b) *the definition of the problem, making reference to the specific section and, when appropriate, an illustrative sketch explaining the question;*
 - (c) *an explanation of circumstances surrounding the actual field conditions; and*
 - (d) *the request for interpretation phrased in such a way that a "yes" or "no" answer will address the issue.*
- (9) *IAPMO does not "approve", "rate", or endorse any item, construction, proprietary device, or activity.*

- (10) IAPMO does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this Standard and does not undertake to insure anyone utilizing this Standard against liability for infringement of any applicable patents, nor assumes any such liability. Users of this Standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their responsibility.*
- (11) Participation by federal or state agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this Standard.*
- (12) Proposals for amendments to this Standard will be processed in accordance with the standards-writing procedures of IAPMO industry standards development, Policy S-001, Standards Development Process.*

IAPMO Standards Review Committee

T. Collings	Building Services & Licensing - Retired Salt Lake City, Utah, USA	<i>Chair</i>
M. Durfee	Chief Building Official - Retired Saratoga Springs, Utah, USA	<i>Vice-Chair</i>
R. Garcia	Senior Mechanical Inspector San Diego, California, USA	
E. Gilbreath	Plumbing Inspector, King County Public Health Puyallup, Washington, USA	
D. Gordon	Plumbing Inspector San Francisco, California, USA	
G. Hile	Chief of Inspections, Municipality of Anchorage – Retired Anchorage, Alaska, USA	
G. Snider	Plumbing Section Supervisor, City of Surrey Surrey, British Columbia, CAN	
M. Wang	Plan Check, City of Los Angeles Monterey Park, California, USA	
S. Choe	IAPMO Farmington Hills, Michigan, USA	<i>Staff Liaison</i>
H. Aguilar	IAPMO Ontario, California, USA	<i>Secretary</i>

IAPMO IGC 396-2024

Water Closet Flange

1 Scope

1.1 Scope

This Standard covers water closet flanges, including off set designs, intended for sanitary and waste applications and specifies requirements for materials, physical characteristics, performance testing, and markings.

1.2 Alternative Materials

The requirements of this Standard are not intended to prevent the use of alternative materials or methods of construction provided such alternatives meet the intent and requirements of this Standard.

1.3 Terminology

In this Standard,

- (a) “shall” is used to express a requirement, i.e., a provision that the user is obliged to satisfy to comply with the Standard;
- (b) “should” is used to express a recommendation, but not a requirement;
- (c) “may” is used to express an option or something permissible within the scope of the Standard; and
- (d) “can” is used to express a possibility or a capability.

Notes accompanying sections of the Standard do not specify requirements or alternative requirements; their purpose is to separate explanatory or informative material from the text. Notes to tables and figures are considered part of the table or figure and can be written as requirements.

1.4 Units of Measurement

SI units are the primary units of record in global commerce. In this Standard, the inch/pound units are shown in parentheses. The values stated in each measurement system are equivalent in application, but each unit system is to be used independently. All references to gallons are to U.S. gallons.

2 Reference Publications

This Standard refers to the following publications and, where such reference is made, it shall be to the current edition of those publications, including all amendments published thereto.

ASTM International

ASTM A48

Standard Specification for Gray Iron Castings

ASTM A888

Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications.

ASTM B117

Standard Practice for Operating Salt Spray (Fog) Apparatus

ASTM D1654

Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments

ASTM D1784

Standard Classification System and Basis for Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds

ASTM D2661

Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe and Fittings

ASTM D2665

Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings

ASTM D3965

Standard Classification System and Basis for Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds

CISPI (Cast Iron Coil Pipe Institute)

CISPI Designation: 301 Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications.

IAPMO (International Association of Plumbing and Mechanical Officials)

IAPMO PS 97

Mechanical Cast Iron Water Closet Flanges

3 Definitions and Abbreviations

3.1 Abbreviations

The following abbreviations apply in this Standard:

VOC — Volatile Organic Compounds

4 General Requirements

4.1 Water Closet Flange Materials

Water closet flanges and their components covered by this Standard shall be made of materials that are suitable for the intended end use.

4.1.1 Cast Iron (gray iron and ductile iron)

Cast iron shall meet the requirements of CISPI 301, Section 4 and Section 11.

or

Grey iron for water closet flanges shall comply with the mechanical and chemical properties for grey iron specified in ASTM A48 Standard Specification for Gray Iron Castings or ASTM A888 Standard Specification for Hubless Cast Iron Soil Pipe and Fittings for Sanitary and Storm Drain, Waste, and Vent Piping Applications. Tensile strength shall not be less than 145 MPa (21,000 psi).

4.1.2 Brass

Brass shall comply with ASTM B584 with a minimum rating of C85710 per ASTM D3965.

4.1.3 ABS

ABS water closet flanges shall comply with the requirements of ASTM D2661 with a minimum cell class rating of 42222 per ASTM D3965.

4.1.4 PVC

PVC water closet flanges shall comply with the requirements of ASTM D2665 with a minimum cell class rating of 12454 per ASTM D1784.

4.2 Coatings

Shall meet the requirements of CISPI 301, Section 6, or Sections 4.1.3.1, 4.1.3.2, and 4.1.3.3 of this Standard.

4.2.1 Lead content

Water closet flange coatings shall not exceed a lead content greater than 0.06%.

4.2.2 VOC content

Water closet flange coatings shall be testing in accordance with ASTM D3960 and shall not exceed 310 grams/liter (2.6 lbs/gallon).

4.2.3 Corrosion resistance

Coatings shall meet the requirements of ASTM D1654 Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments using ASTM B117 Standard Practice for Operating Salt Spray (Fog) Apparatus.

4.3 Fasteners

Fasteners shall be made of stainless steel alloys of the 300 series.

4.4 Gaskets

Gasket materials shall comply with ASTM C564 when provided.

4.5 Design and Construction Dimensions

4.5.1 The water closet flange shall sit flush with the mounting surface in accordance with the manufacturer's installation instructions.

4.5.2 A water closet flange shall meet the dimensional requirements of Table 1.

4.6 Mechanical Water Closet Flange

Mechanical water closet flanges shall be tested to the hydrostatic joint tightness requirements of IAPMO PS 97 Section 5.

5 Markings and Accompanying Literature

5.1 Markings

Water closet flanges complying with this Standard shall be marked with the:


- (a) manufacturer's name or trademark;
- (b) model number;
- (c) IAPMO standard designation or certification mark (i.e., IAPMO IGC 396);
- (d) country of origin
- (e) foundry code
- (f) date code

5.2 Visibility

Markings shall be permanent, legible, and visible after installation.

5.3 Installation Instructions

Water closet flanges shall be accompanied by instructions for their installation or be provided with a means to acquire the instructions.

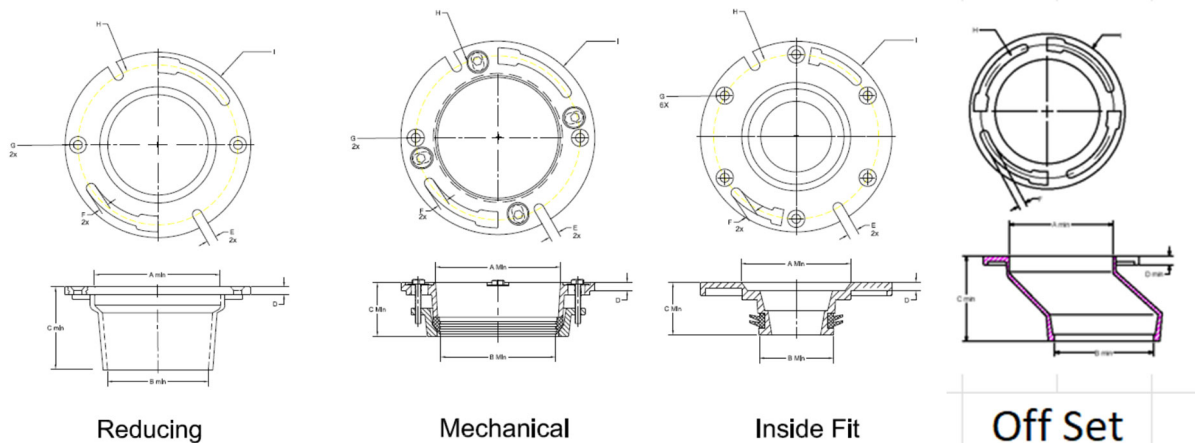

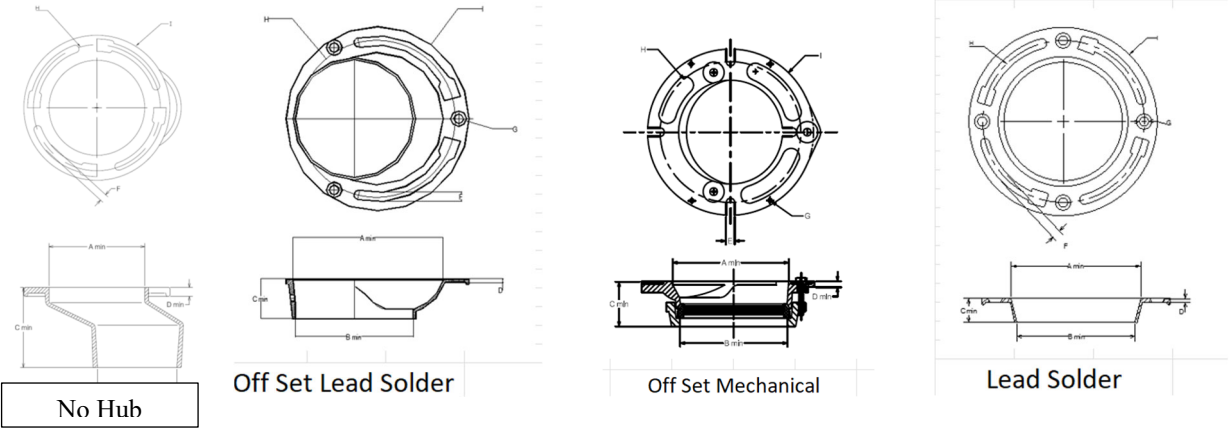


Table 1

(See Section 4.5.2)

Style	Size	A min	B min	C min	D	Tolerance	E	Tolerance	F	Tolerance	G	Tolerance	H	Tolerance	I	Tolerance
Mechanical	3"	3"	3"	2"	0.3125"	± .125"	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3437"	± .125"	6.25"	± .125"	7.375"	± .125"
Reducing	4" x 3"	4"	3"	3"	0.406"	± .125"	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3437"	± .125"	6.25"	± .125"	7.250"	± .125"
Inside Fit	3"	4"	2.75"	2"	0.2002"	± .125 "	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3125"	± .125"	6.25"	± .125"	7.250"	± .125"
Inside Fit	4"	4"	3.625"	2"	0.2044"	± .125"	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3125"	± .125"	6.25"	± .125"	7.250"	± .125"
No Hub	3"	4"	3"	3.5"	0.3125"	± .125"	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3437"	± .125"	6.00"	± .125"	7.250"	± .125"
No Hub	4"	5"	7"	4"	0.3125"	± .125"	0.375"	+ 0.000" - 0.312"	0.375"	+ 0.000" - 0.312"	0.3437"	± .125"	6.00"	± .125"	7.250"	± .125"
Off Set	4"	4"	3.938"	2"	0.5156"	± .125"	N/A	N/A	0.375"	+ 0.000" - 0.312"	N/A	N/A	6.25"	± .125"	7.250"	± .125"
Off Set Mechanical	4"	4"	4"	2"	0.5156"	± .125"	0.375"	+ 0.000" - 0.312"	N/A	+ 0.000" - 0.312"	0.1875"	± .125"	6.25"	± .125"	7.375"	± .125"
Off Set Lead Solder	4"	5"	4"	1.5"	0.1181"	± .125"	N/A	N/A	0.350"	+ 0.000" - 0.312"	0.3437"	± .125"	6.00"	± .125"	7.000"	± .125"
Lead Solder	4"	5"	4"	0.31"	0.27"	± .125"	N/A	N/A	0.375"	+ 0.000" - 0.312"	0.3437"	± .125"	6.25"	± .125"	7.250"	± .125"



**International Association of Plumbing and
Mechanical Officials (IAPMO)**

4755 East Philadelphia Street | Ontario, California, 91761

1-800-854-2766 | 1-909-472-4100 | www.IAPMOstandards.org

**For
Devices for Detection, Monitoring or**